

Exova  
2395 Speakman Dr.  
Mississauga  
Ontario  
Canada  
L5K 1B3

T: +1 (905) 822-4111  
F: +1 (905) 823-1446  
E: sales@exova.com  
W: www.exova.com



Testing. calibrating. advising

## CAN/ULC-S102 Surface Burning Characteristics of "VIXUM IWN-380"

A Report To: **Dongsung Chemical Co., Ltd.**  
19, Hasinbeonyeong-ro, Saha-gu  
Busan 49470  
Korea

Phone: +82-(0) 1092045676

Attention: Brown Gwack  
E-mail: yunyrub@idongsung.com

Submitted by: Exova Warringtonfire North America

Report No. 18-002-390(A)  
4 Pages

Date: July 20, 2018

**ACCREDITATION** To ISO/IEC 17025 for a defined Scope of Testing by the International Accreditation Service

### **SPECIFICATIONS OF ORDER**

Determine the Flame Spread and Smoke Developed Values based upon a single screening test only, conducted in accordance with CAN/ULC-S102-10, as per Exova Warringtonfire North America Quotation No. 18-002-563,583 accepted July 2, 2018.

**SAMPLE IDENTIFICATION** (Exova sample identification number 18-002-S0390-1)

Material described as, "Melamine Foam, white color", and identified as:  
"VIXUM IWN-380"

### **TEST PROCEDURE**

The method, designated as CAN/ULC-S102-10, "Standard Method of Test for Surface Burning Characteristics of Building Materials and Assemblies", is designed to determine the relative surface burning characteristics of materials under specific test conditions. Results of less than three identical specimens are expressed in terms of Flame Spread Value (FSV) and Smoke Developed Value (SDV). Results of three or more replicate tests on identical samples produce average values expressed as Flame Spread Rating (FSR) and Smoke Developed Classification (SDC). FSR and SDC are the values cited by Canadian Building codes.

Although the procedure is applicable to materials, products and assemblies used in building construction for development of comparative surface spread of flame data, the test results may not reflect the relative surface burning characteristics of tested materials under all building fire conditions.

### **SAMPLE PREPARATION**

The test specimen consisted of a total of four sections of material, each approximately 229 mm in total measured thickness by 533 mm in width by 1829 mm in length. The sections were butted together to create the total specimen length. Prior to testing, the specimen was conditioned to constant mass at a temperature of  $23 \pm 3^{\circ}\text{C}$  and a relative humidity of  $50 \pm 5\%$ . During testing, the specimen was supported across its width by 6 mm steel rods spaced nominally at 610 mm intervals.

The testing was performed on: 2018-07-18

### **SUMMARY OF TEST PROCEDURE**

The tunnel is preheated to  $85^{\circ}\text{C}$ , as measured by the backwall-embedded thermocouple located 7090 mm downstream of the burner ports, and allowed to cool to  $40^{\circ}\text{C}$ , as measured by the backwall-embedded thermocouple located 4000 mm from the burners. At this time the tunnel lid is raised and the test sample is placed along the ledges of the tunnel so as to form a continuous ceiling 7315 mm long, 305 mm above the floor. The lid is then lowered into place.

**SUMMARY OF TEST PROCEDURE (continued)**

Upon ignition of the gas burners, the flame spread distance is observed and recorded every second. Flame spread distance versus time is plotted. Calculations ignore all flame front recessions and the Flame Spread Value (FSV) is determined by calculating the total area under the curve for the test sample. If the total area under the curve (AT) is less than or equal to 29.7 m·min, FSV = 1.85·AT; if greater, FSV = 1640/(59.4-AT).

The Smoke Developed Value is determined by comparing the area under the obscuration curve for the test sample to that of inorganic reinforced cement board and red oak, established as 0 and 100, respectively. The Smoke Developed Value (SDV) is determined by dividing the total area under the obscuration curve by that of red oak and multiplying by 100.


**TEST RESULTS**

SAMPLE: "VIXUM IWN-380"

Approx. Time to Ignition (s)	Maximum Flame Front Distance (m)	Time to Maximum Flame Front (s)	Maximum Air Temperature (°C)	Flame Spread Value (FSV)	Smoke Developed Value (SDV)
8	0.00	0	330	0	15

**Observations of Burning Characteristics**

The specimen ignited approximately 8 seconds after exposure to the test flame. The flame front did not advance past the base line.



Francis Williams,  
Technician.



Ian Smith,  
Technical Manager.

Note: This report and service are covered under Exova Canada Inc. Standard Terms and Conditions of Contract which may be found on the Exova website ([www.exova.com](http://www.exova.com)), or by calling 1-866-263-9268.

Test Charts

Sample: "VIXUM IWN-380"

Chart 1. FLAME SPREAD

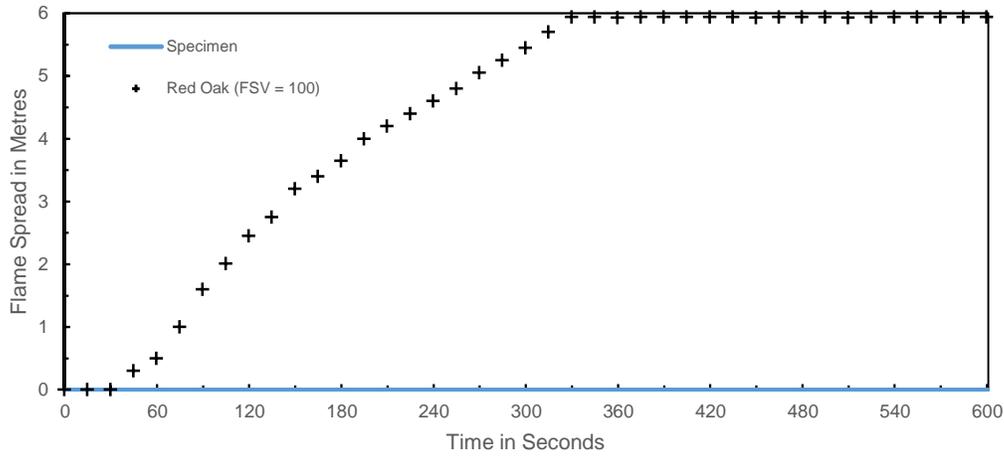


Chart 2. SMOKE DEVELOPED


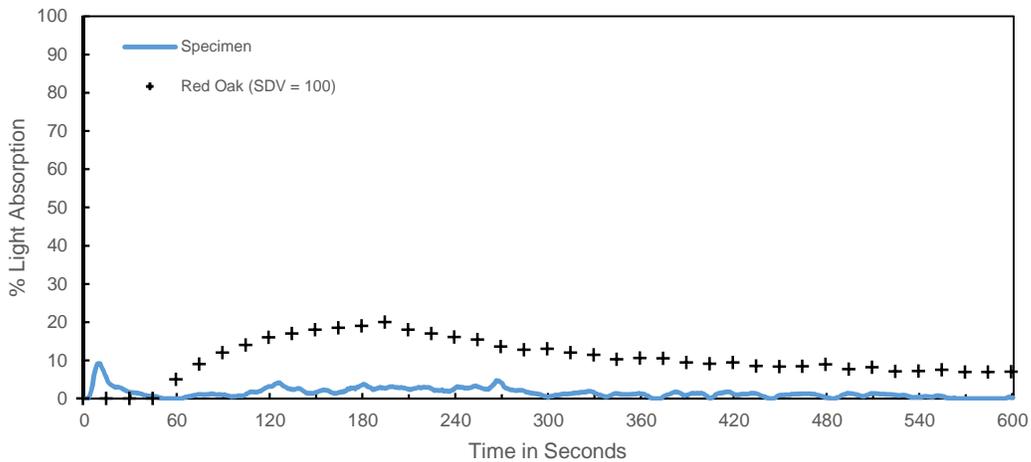


Chart 3. TEMPERATURE

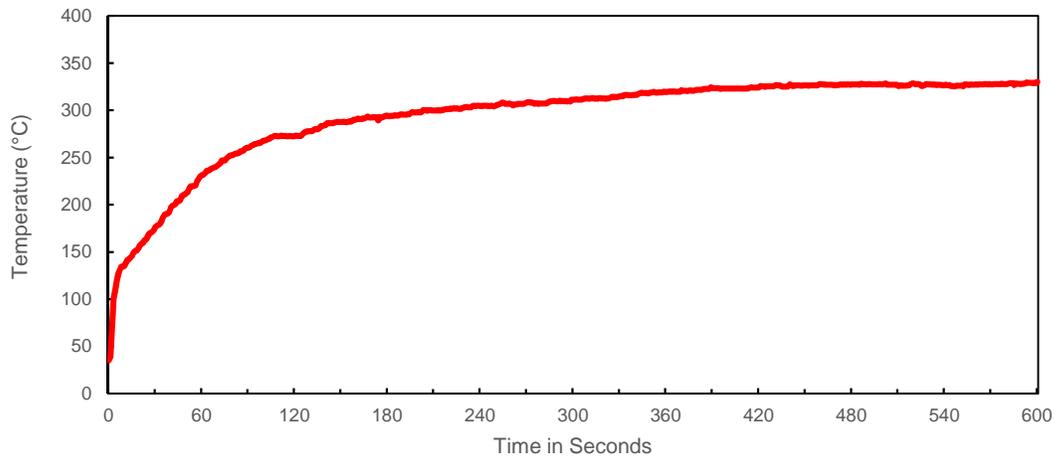

Flame Spread  
Value (FSV)

0

Smoke Developed  
Value (SDV)

15

Maximum Air  
Temperature (°C)

330